


563 44

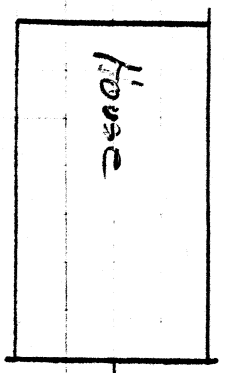

connected to septic tank 1100 gal.

Permit # 30-21039

BRUCE W. HENDERSON

Bruce W. Henderson
Waste Mgt. Specialist ERO

Dept. of Environmental Quality

Date 12/29/88

- ① Old septic tank to be properly abandoned - submit certification & copy of pump receipt.
- ② Effluent line - heavy duty pipe 4" / 100' minimum grade
- ③ Each line level end-to-end with 2" to 3" trench depth
- ④ 10' setback from top of driveway cutbank
- ⑤ Boxes connected to drain lines via minimum 4' long solid level header lines bedded in compacted soil

received by 12-19-88

